




## FIRE SPRINKLER PERMIT PROCESS

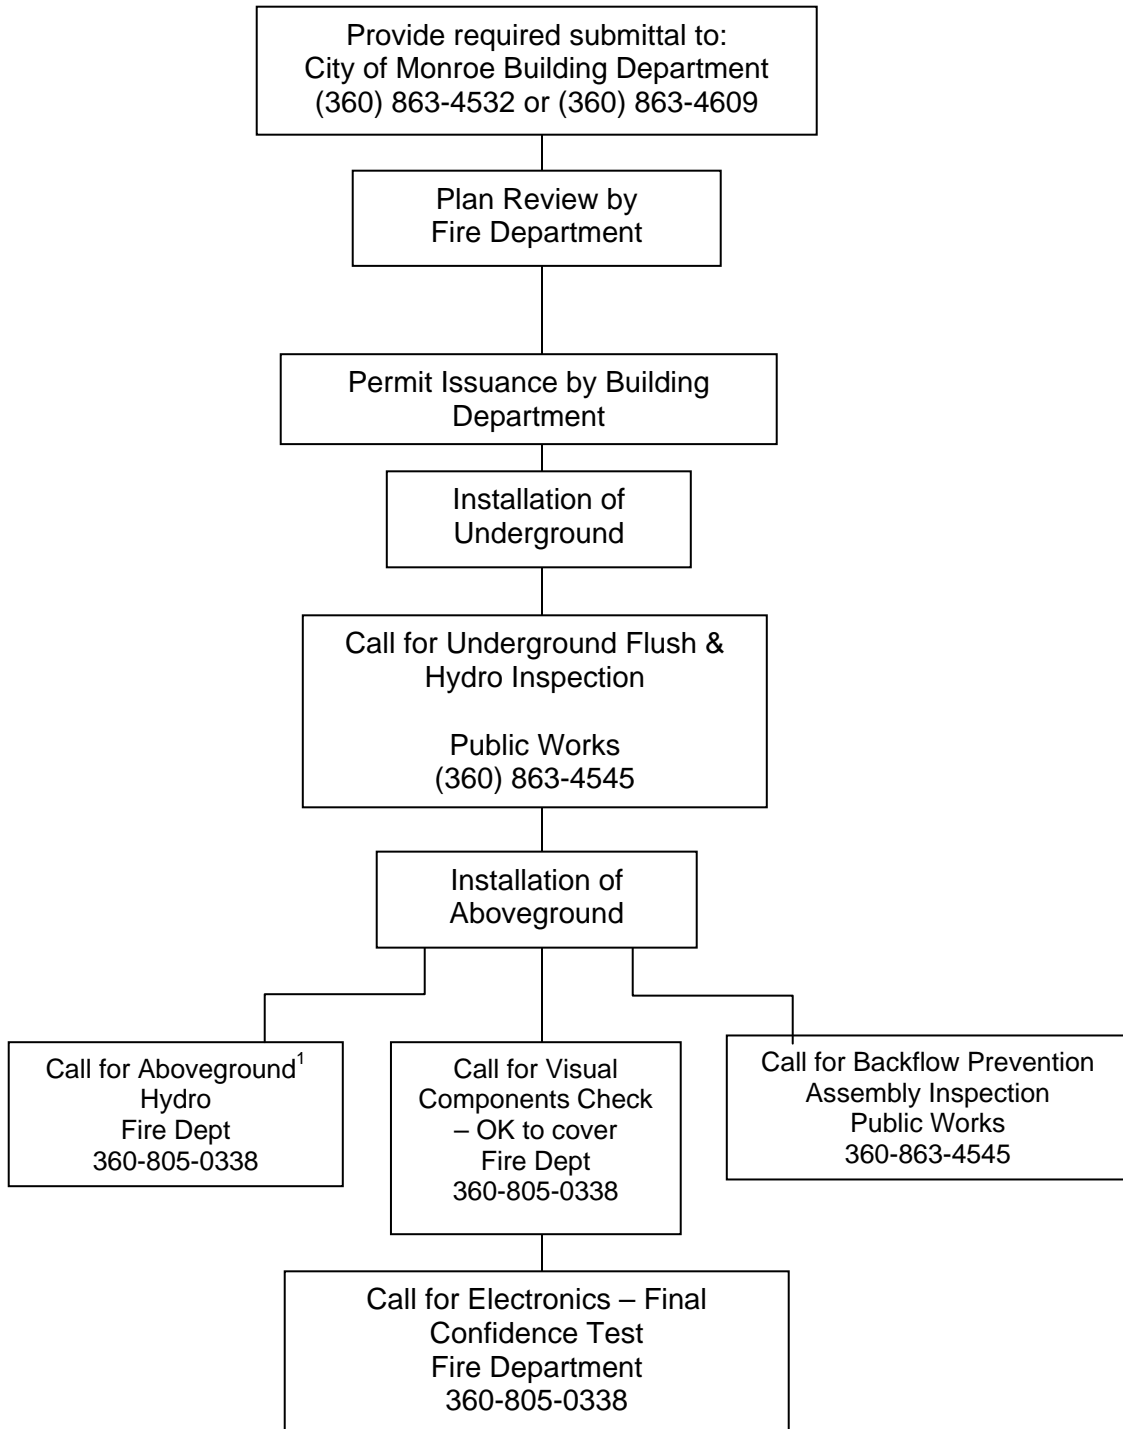

<sup>1</sup>Aboveground Pneumatic Test/Dry Pipe Air Trip Test required for Dry Systems. Bucket Test required for 13D and 13R systems.